

产品认证证书

II型自愿认证

证书编号: CQC2012010307534810

发证日期: 2021年10月14日

有效期至: 2031年10月14日

委托人名称及注册地址 ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

制造商名称及注册地址 ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产企业名称及生产地址 ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号 塑料外壳式断路器
A3N400, A3S400, M3S400, M3N400; 规格参数详见附件

产品标准和技术要求 GB/T 14048.2-2020

认证模式 产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2020年08月14日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站 (www.cnca.gov.cn) 查验证书信息



授权签字人

签发

刘江

谢肇煦

中国质量认证中心



<http://www.cqc.com.cn>

中国·北京·南四环西路188号9区 100070

电话: +86 10 83886666

C(2) 0096433

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2012010307534810

Valid from: Oct.14,2021

Valid until: Oct.14,2031

NAME AND REGISTERED ADDRESS OF THE APPLICANT ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND REGISTERED ADDRESS OF THE MANUFACTURER ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND LOCATION OF THE FACTORY ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION Moulded Case Circuit-breaker
A3N400, A3S400, M3S400, M3N400; See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS GB/T 14048.2-2020

TYPE OF CERTIFICATION SCHEMES Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Aug.14,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGN BY

刘江

SIGNATURE

谢肇煦

CHINA QUALITY CERTIFICATION CENTRE



产品认证证书

II型自愿认证

证书编号: CQC2012010307534810

第1页 共3页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 96433

上报参数:

A3N400、A3S400、M3S400、M3N400

Uimp : 6kV ;

Ui : 690V ;

Ue : AC230V,AC240V , AC380V,AC415V , AC480V , AC550V , DC250V ;

In : 250A , 320A(单磁式) ; 320A , 400A(热磁式) ;

过电流脱扣器类型: 热磁式, 单磁式 ;

AC230,240V:Icu = 85kA,Ics = 50%Icu;(M3N400,A3N400)

Icu = 100kA,Ics = 50%Icu;(M3S400,A3S400)

AC380,415V:Icu = 36kA,Ics = 50%Icu;(M3N400,A3N400)

Icu = 50kA,Ics = 50%Icu;(M3S400,A3S400)

AC480V:Icu = 25kA,Ics = 50%Icu;(M3N400,A3N400)

Icu = 35kA,Ics = 50%Icu;(M3S400,A3S400)

AC550V:Icu = 15kA,Ics = 50%Icu;(M3N400,A3N400)

Icu = 20kA,Ics = 50%Icu;(M3S400,A3S400)

DC250V(两级串联):Icu = 36kA,Ics = 50%Icu;(M3N400,A3N400)

Icu = 50kA,Ics = 50%Icu;(M3S400,A3S400)

选择性类别: A ;

适用隔离 ;

适用频率: 50/60Hz ;

极数: 3P , 4P(3个保护极, N极可开闭) ;



中国质量认证中心



产品认证证书

II型自愿认证


证书编号：CQC2012010307534810

第 2 页 共 3 页


本证书及附件应同时使用，信息查验说明见证书页

纸号：96433

直流接线方式示意图如下：

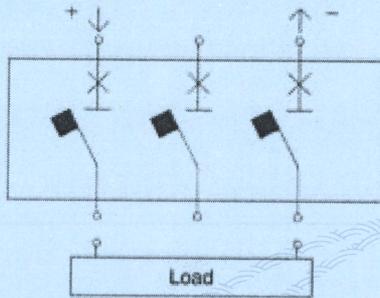

3P 外形产品接线图

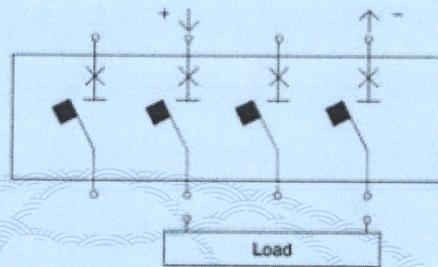

4P 外形产品接线图



中国质量认证中心



产品认证证书

II型自愿认证

证书编号: CQC2012010307534810

第3页 共3页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 96433

型号解释:

A3 N 400
结构段电流: 400
分断能力: N, S
Formula系列塑壳断路器, 框架型号3

M3 N 400
结构段电流: 400
分断能力: N, S
Formula系列塑壳断路器, 框架型号3



中国质量认证中心

