

# 产品认证证书

## II型自愿认证

证书编号: CQC2012010307572508

发证日期: 2021年10月14日

有效期至: 2031年10月14日

**委托人名称及注册地址** ABB 新会低压开关有限公司  
广东省江门市新会区今古洲工业开发区

**制造商名称及注册地址** ABB 新会低压开关有限公司  
广东省江门市新会区今古洲工业开发区

**生产企业名称及生产地址** ABB 新会低压开关有限公司  
广东省江门市新会区今古洲工业开发区

**产品名称和系列、规格、型号** 塑料外壳式断路器  
A3N630, A3S630, M3S630, M3N630; 规格参数详见附件

**产品标准和技术要求** GB/T 14048.2-2020

**认证模式** 产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2020年08月14日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站 ( www.cnca.gov.cn ) 查验证书信息



授权签字人

签发

刘江

谢肇煦

中国质量认证中心



<http://www.cqc.com.cn>

中国·北京·南四环西路188号9区 100070

电话: +86 10 83886666

C(2) 0096434

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2012010307572508

Valid from: Oct.14,2021

Valid until: Oct.14,2031

**NAME AND REGISTERED ADDRESS OF THE APPLICANT** ABB Xinhui Low Voltage Switchgear Co.,Ltd.  
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

**NAME AND REGISTERED ADDRESS OF THE MANUFACTURER** ABB Xinhui Low Voltage Switchgear Co.,Ltd.  
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

**NAME AND LOCATION OF THE FACTORY** ABB Xinhui Low Voltage Switchgear Co.,Ltd.  
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

**PRODUCT NAME, MODEL AND SPECIFICATION** Moulded Case Circuit-breakers  
A3N630, A3S630, M3S630, M3N630; See the Appendix

**THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS** GB/T 14048.2-2020

**TYPE OF CERTIFICATION SCHEMES** Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Aug.14,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: [www.cnca.gov.cn](http://www.cnca.gov.cn)



SIGN BY

SIGNATURE



CHINA QUALITY CERTIFICATION CENTRE



# 产品认证证书

## II型自愿认证

证书编号: CQC2012010307572508

第1页 共2页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 96434

上报参数:

A3N630、A3S630、M3S630、M3N630

Uimp: 6kV;

Ui: 690V;

Ue: AC230V,AC240V,AC380V,AC415V,AC480V,AC550V,DC250V(仅热磁式);

In: 400A(MF),500A(TMF,ELT I),630A(ELT LI);

过电流脱扣器类型: 电子式,热磁式,单磁式;

AC230,240V: Icu = 85kA, Ics = 50%Icu; (M3N630, A3N630)

Icu = 100kA, Ics = 50%Icu; (M3S630, A3S630)

AC380,415V: Icu = 36kA, Ics = 50%Icu; (M3N630, A3N630)

Icu = 50kA, Ics = 50%Icu; (M3S630, A3S630)

AC480V: Icu = 25kA, Ics = 50%Icu; (M3N630, A3N630)

Icu = 35kA, Ics = 50%Icu; (M3S630, A3S630)

AC550V: Icu = 15kA, Ics = 50%Icu; (M3N630, A3N630)

Icu = 20kA, Ics = 50%Icu; (M3S630, A3S630)

DC250V(两级串联): Icu = 36kA, Ics = 50%Icu; (M3N630, A3N630)

Icu = 50kA, Ics = 50%Icu; (M3S630, A3S630)

选择性类别: A;

适用隔离;

适用频率: 50/60Hz;

极数: 3P,4P



中国质量认证中心



# 产品认证证书

## II型自愿认证


证书编号：CQC2012010307572508

第 2 页 共 2 页

本证书及附件应同时使用，信息查验说明见证书页



纸号：96434

直流接线方式示意图如下：

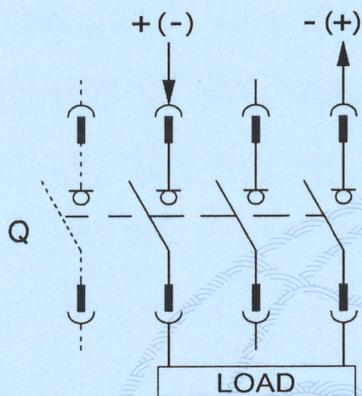

两极串（3P，4P外形）

型号解释：

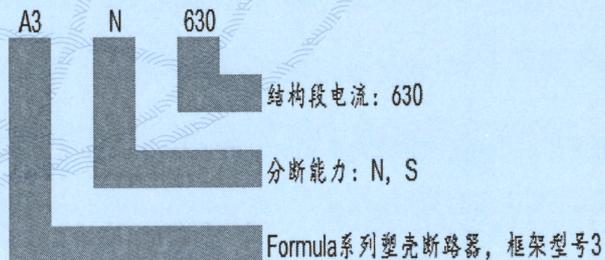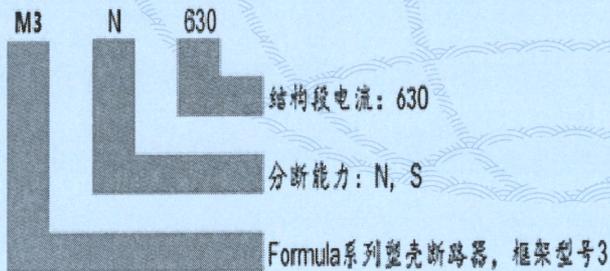

中国质量认证中心

