

产品认证证书

II型自愿认证

证书编号: CQC2012010305523382

发证日期: 2024年01月29日
有效期至: 2031年08月30日

委托人名称 及注册地址 ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

制造商名称 及注册地址 ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产企业名称 及生产地址 ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号 双电源转换开关
OT2000C, OT2500C, OTM2000C, OTM2500C, OTM2000C_D, OTM2500C_D; 详见附件

产品标准和技术要求 GB/T 14048.11-2016

认证模式 产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2020年08月14日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站 (www.cnca.gov.cn) 查验证书信息



授权签字人

郑士泉

签发

谢肇煦

中国质量认证中心



<http://www.cqc.com.cn>

中国·北京·南四环西路188号9区 100070

电话: +86 10 83886666

C(2) 0272131

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2012010305523382

Valid from: Jan.29,2024

Valid until: Aug.30,2031

NAME AND REGISTERED ADDRESS OF THE APPLICANT ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND REGISTERED ADDRESS OF THE MANUFACTURER ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND LOCATION OF THE FACTORY ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION Transfer Switch_
OT2000C, OT2500C, OTM2000C,OTM2500C, OTM2000C_D, OTM2500C_D; See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS GB/T 14048.11-2016

TYPE OF CERTIFICATION SCHEMES Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Aug.14,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGN BY

郑士泉

SIGNATURE

谢肇煦



CHINA QUALITY CERTIFICATION CENTRE



<http://www.cqc.com.cn>

Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86 10 83886666

C(2) 0272131

产品认证证书

II型自愿认证

证书编号: CQC2012010305523382

第 1 页 / 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 272131

OT2000C, OT2500C, OTM2000C,
OTM2500C, OTM2000C_D, OTM2500C_D
额定冲击耐受电压(Uimp): 12kV(手动式, 电动式), 6kV(自动式配 OMD300, OMD800 控制器),
8kV(自动式配 OTM_C20D, OTM_C21D 控制器);
控制器额定冲击耐受电压(Uimp): 4kV(OMD300, OMD800), 6kV(OTM_C20D, OTM_C21D);
额定绝缘电压(Ui): 1000V;
约定发热电流(Ith): 2000A(OT2000C, OTM2000C, OTM2000C_D),
2500A(OT2500C, OTM2500C, OTM2500C_D);
额定工作电压(Ue): AC415V(手动式, 电动式), AC380V(自动式配 OMD300, OMD800 控制器),
AC380V, AC400V, AC415V(自动式配 OTM_C20D, OTM_C21D 控制器);
额定工作电流(Ie): 2000A;
使用类别: AC-31B;
额定短路接通能力 Icm(峰值): 110kA;
额定短时耐受电流 Icw: 50kA/0.1s;
电器级别: PC 级;
转换方式: MTSE, RTSE, ATSE;
极数: 3P, 4P



中国质量认证中心



产品认证证书

II型自愿认证


证书编号: CQC2012010305523382

第 2 页 / 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 272131

型号解释:

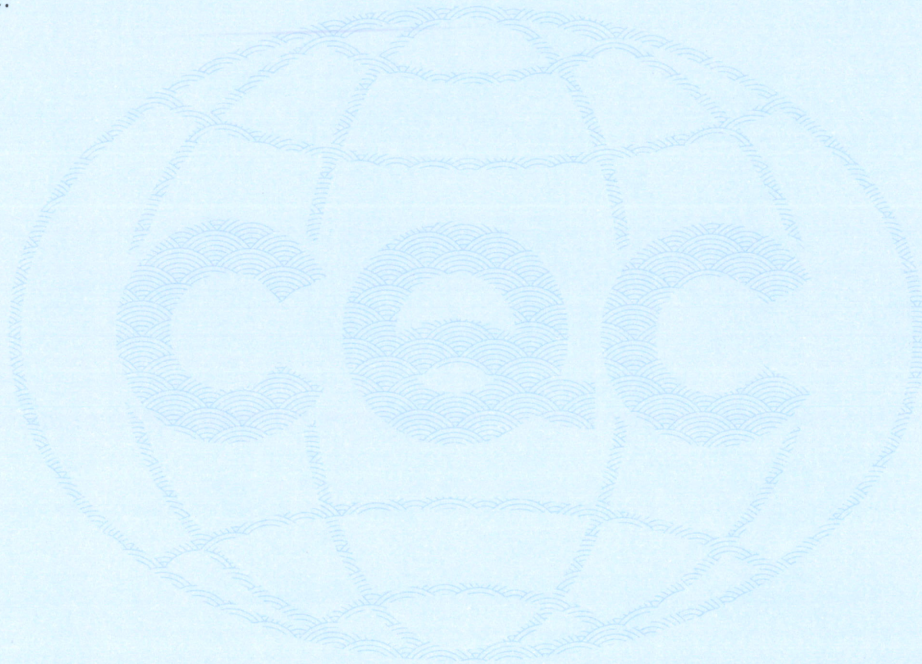

中国质量认证中心



产品认证证书

II型自愿认证

证书编号: CQC2012010305523382

第 3 页 / 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 272131

OT 2000 E 04 C P _ _
 ① ② ③ ④ ⑤ ⑥ ⑦ ⑧

- ①产品型号 OT 手动式
 OTM 电动式/自动式
 ②约定发热电流: 2000、2500
 ③E 符合 IEC 标准
 ④极数及位置识别码

手动式			
03	操作机构左边 0 极, 右边 3 极	04	操作机构左边 0 极, 右边 4 极
12	操作机构左边 1 极, 右边 2 极	13	操作机构左边 1 极, 右边 3 极
		22	操作机构左边 2 极, 右边 2 极
电动式/自动式			
3	操作机构右边 3 极	4	操作机构右边 4 极

- ⑤转换开关 C 双电源转换开关
 ⑥操作方式 空白: 不配手柄的手动式转换开关
 P: 手枪式手柄
 K: 直接安装式手柄
 M: 按钮操作
 3D: OMD300 控制器
 8D: OMD800 控制器
 20D: OTM_C20D 控制器
 21D: OTM_C21D 控制器
 ⑦操作机构工作电压: 空白: 手动转换开关
 220C: 交流 220Vac
 230C: 交流 230Vac.
 380C: 交流 380Vac, 400Vac, 415Vac
 ⑧客户标识: 空白: 一般客户
 A-Z: 固定客户
 N: 仅适用于 OTM_C20D, OTM_C21D



中国质量认证中心

